



**State of North Carolina
Haywood County Schools**

401 Farmview Drive
Waynesville, NC 28786
828 456 2402

REQUEST FOR PROPOSAL - RFP 14-21

Proposal Issue Date: April 28, 2021

LOCATION: Canton Middle School Media Center

PROJECT: Asbestos Abatement Services

Refer ALL Inquiries to: Brandon McGaha

Phone: (828) 456-2402

Cell: (828) 593-9257

E-Mail: bmcgaha@haywood.k12.nc.us

Project Designer: Mike Cook

Cell: (828) 508-3812

E-Mail: mcook@affinityenv.com

NOTICE TO OFFERER

Sealed proposals subject to the conditions made a part hereof will be received in this office until **1:00 pm EST on Wednesday, May 5, 2021** for furnishing all labor, materials, equipment, and services incidental and implied, for completion of the project described herein.

PRE-BID MEETING

No pre-bid meeting is scheduled. Contractors may contact Brandon McGaha, Special Projects Lead at (828) 593-9257 during regular business hours with any questions or to visit site if desired.

SEND ALL SEALED PROPOSALS DIRECTLY TO THE ADDRESS SHOWN BELOW:

Haywood County Schools Maintenance Department
Attention: Josh Mease
401 Farmview Drive
Waynesville, NC 28786

Direct inquiries concerning this RFP to:

Josh Mease, Maintenance Director

Email: jmease@haywood.k12.nc.us

Mobile: (828) 734-5570.

Office: (828) 456-2402

THE PROCUREMENT PROCESS

The following is a general description of the process by which a firm will be selected to provide services.

1. Request for Proposals (RFP) is issued to prospective contractors.
2. Proposals in one original will be received from each offeror in a sealed envelope or package. Each original shall be signed and dated by an official authorized to bind the firm. Unsigned proposals will not be considered.
3. All proposals must be received by the issuing agency no later than the date and time specified on the cover sheet of this RFP.
4. At that date and time the proposals from each responding firm will be opened. Interested parties are cautioned that these costs and their components are subject to further evaluation for completeness and correctness and therefore may not be an exact indicator of an offeror's pricing position. Proposals are confidential until such time that award has been made. Thereafter, the Maintenance Department will furnish a bid tab upon request.
5. Proposals will be evaluated according to completeness, content, and experience with similar projects, ability of the offeror and its staff, and cost. Award of a contract to one offeror does not mean that the other proposals lacked merit, but that, all factors considered, the selected proposal was deemed most advantageous to Haywood County Board of Education.
6. Offerors are cautioned that this is a request for offers, not a request to contract, and the Haywood County Board of Education reserves the unqualified right to reject any and all offers when such rejection is deemed to be in its best interest.

ASBESTOS ABATEMENT SERVICES FOR CANTON MIDDLE SCHOOL MEDIA CENTER RFP# 14-21

PRE-BID MEETING: No pre-bid meeting is scheduled. Contractors may contact Brandon Mcgaha, Special Projects Lead at (828) 593-9257 during regular business hours with any questions or to visit each site if desired.

JOB SPECIFICATIONS: See attached design specifications for Asbestos Abatement Services for Canton Middle School Media Center

SCOPE: Work shall consist of furnishing all labor, materials, equipment and services, incidental and implied, for this job. All items not specifically mentioned in the specifications, but which are obviously required to make the renovations complete, shall be included automatically.

QUESTIONS: Questions that are technical in nature shall be directed to Josh Mease, Maintenance Director at (828) 734-5570.

QUALIFICATIONS: All bidders are required to have at least three (3) years of experience and supply three (3) references in this area if asked for them.

CONTRACTOR'S RESPONSIBILITY: The Contractor shall be responsible for the construction site during the performance of the work. The Contractor shall be responsible for any and all damages to persons and property during the performance of the work and shall further provide all necessary safety measures and shall fully comply with all federal state and local laws, building rules, rules and regulations to prevent accidents or injury to persons or property on or about the location of the work site. This is to include OSHA 1910, General Construction, or those regulations mandated by these specifications. Special attention shall be made to proper barricading of the work area.

SAFETY REGULATIONS: The Contractor shall adhere to the rules, regulations and interpretations of all state, federal and local laws, which pertain to works and site safety. This is to include OSHA 1910, General Construction, or those regulations mandated by these specifications.

CODES: All work shall be done in accordance with the specifications and shall comply with North Carolina Building Code, Underwriters' Rules and Regulations and Federal, State and Local Regulations covering work of this nature. Whenever drawings or specifications are in excess of such laws, codes and regulations, the specifications shall hold. All equipment shall have U. L. labels attached.

PERMITS: The Contractor shall hold the appropriate license for work to be performed and shall secure all permits required for the job completion, obtain and deliver to the Owner, all certification of inspection issued by the authorities having jurisdiction and roofing material manufacturer. Contractor is responsible for paying all costs associated with Haywood County building permits. **All final certificates must be delivered to the owner prior to request for final payment.**

SCHOOL SECURITY & ACCESS: Security, safety and protection of the instructional environment are priority concerns of Haywood County Schools. The Contractor shall confine activities to the work area and shall not engage or interact with students, teachers or staff that are not designated as contact personnel. The Contractor shall screen all employees on-site; and, at the request of the Owner, provide documentation that employees and subcontractors meet standards. The Owner, school staff and Contractor shall designate contact personnel and provide contact information to assist in the resolution of any logistical or safety issues beforehand, or that may arise during construction.

SCHEDULING: The Contractor must submit a precise time schedule as to when specific work will occur in specific areas within the building. This will be used to coordinate the work with the occupants of the building. The Maintenance Director, may alter the schedule at any time to maintain the work process within the facility. Work must be scheduled during hours that are acceptable to the Haywood County Board of Education and shall not incur any additional cost due to scheduling.

WORKERS ON THE JOB: All employees of the Contractor shall, while on Haywood County Board of Education property, must act in a professional and courteous manner. All workers shall be expected to wear shirts while on Board property. Also, all employees of the Contractor must "sign in" in the main office upon entering the facility and must "sign out" upon leaving the property. Any employee of the Contractor may be told to leave the property by the Maintenance Director if they do not follow these procedures. The employee shall be replaced with another at no additional cost to the Haywood County Board of Education. **NOTE: There needs to be one person on each site that speaks fluent English.**

In accordance with G.S. 14-208.18, all persons who (1) are required to register under the Sex Offender and Public Protection Program and (2) have been convicted of certain sexually violent offenses or any offense where the victim was under the age of 16 years at the time of the offense are expressly forbidden to knowingly be present on any property owned or operated by the school system, including school buildings, athletic fields, playgrounds, parking lots, school buses, activity buses or other property of any kind for any reason, including attendance at sporting events or other school related functions, whether before, during or after school hours. It is the responsibility of the contractor or vendor that their employees and subcontractors are in accordance with G.S. 14-208.18.

PRICE ADJUSTMENTS: (TERM CONTRACTS ONLY): Any price changes, downwards or upwards, which might be permitted during the contract period must be general, either by reason of market change or on the part of the contractor to the other customers.

- a) **Notification:** Must be given to Haywood County Schools, in writing, concerning any proposed price adjustments. Such notifications shall be accompanied by a copy of the manufacturer's official notice or other acceptable evidence that the change is general in nature.
- b) **Decreases:** Haywood County Schools shall receive full proportionate benefit immediately at any time during the contract.
- c) **Increases: Consumer Price Index (CPI):** Contract prices for equipment and/or service will remain firm through June 30, 2021. Contractors must request price adjustments, in writing 30 days prior to the renewal date. If a Contractor fails to request CPI price adjustment 30 days prior to the adjustment date, the adjustment will be effective 30 days after Haywood County Schools receives their written request. Price adjustments will be made in accordance with the percentage change in the U.S Department of Labor Consumer Price Index (CPI-U) for all urban consumers, all items, and the southern region. The price adjustment rate will be determined by comparing the percentage difference between the CPI in effect for the base yearly average (January through December beginning the year 2020); and each (January through December) thereafter. The percentage difference between those two (2) CPI issues will be the price adjustment rate. No retroactive contract price adjustments will be allowed. All bidders will be capped with a 3% maximum price increase.
- d) **Invoices:** It is understood and agreed that orders will be shipped at the established contract prices in effect on dates orders are placed. Invoicing at variances with this provision will subject the contract to cancellation. Applicable North Carolina sales tax shall be invoices as a separate item.

EQUIPMENT AND TOOLS: The Contractor shall use no equipment or tools that are owned by the Haywood County Board of Education. Also, the contractor except for opening locked gates, doors, etc., and giving directions shall utilize no employees of Haywood County Schools. Questions of a technical nature shall be directed to the Maintenance Director.

MATERIALS: No materials shall be stored on site and the Haywood County Board of Education is not responsible for any materials, equipment or tools lost or stolen from the site. Any materials needed to complete the job shall be included in the bid.

CLEAN UP: The area of work shall be cleaned daily so that the Haywood County Board of Education shall not incur any additional costs to make the area suitable for the educational process. Also, the Contractor shall utilize no trash receptacles or dumpsters owned by the Haywood County Board of Education. All trash and debris shall be properly disposed of off the property.

PERFORMANCE OF WORK: All work shall be performed at the highest level of quality. The Owner shall be responsible for determining the quality of work, and may notify the Contractor of the same. **ANY WORK COMPLETED THAT IS NOT SUITABLE TO THE OWNER SHALL BE REPEATED BY THE CONTRACTOR AT NO COST TO THE OWNER.** Any damage to existing areas or utilities will be the responsibility of the Contractor. **NO EXCEPTIONS.**

WARRANTY: All labor, materials, equipment and services shall be warranted for one year from acceptance of job.

Contractor must adhere to the guidelines within these specifications; failure to do so will result in default of payment by the Haywood County Board of Education and/or cancellation of this contract.

The Haywood County Boards of Education reserves the right to reject any or all bids for any or no reason, and to waive informalities.

END OF RFP

Asbestos Abatement Services For Canton Middle School Media Center

RFP 14-21

CANTON MIDDLE SCHOOL - BASE BID

- It will be the Owner's responsibility to remove any furniture or personal belongings from the immediate working area prior to the project start date.
- The Owner shall be responsible for moving all IT wiring, etc. at least 4 feet off the ground prior to the job start date.
- The asbestos project work area shall be constructed in accordance with OSHA standards for the appropriate work being performed.
- The Owner will be responsible for supplying power or water services.
- Any and all applicable regulations shall be followed and all omissions contained.
- Generated waste shall be placed in an asbestos bag, double bagged, labeled and delivered to an accredited landfill.
- An electronic report shall be submitted within 45 days of the project work, including a project waste shipment record.
- This project cost estimate shall include applicable asbestos permitting and disposal fees.
- City or County demo fees are the responsibility of the Owner or Owner's representative.
- Owner will be responsible for providing air monitoring services.
- Contractor will not be able to start work until July 1, 2021
- Contractor will be responsible for checking out a key from the Maintenance Department.
- Contractor will be responsible for pulling all permits.
- Contractor will provide and install all materials.
- This project can be done during regular business hours.



SPECIFICATIONS
For The
REMOVAL
Of
ASBESTOS-CONTAINING FLOORING MATERIALS
At
CANTON MIDDLE SCHOOL
60 PENLAND STREET
CANTON, NORTH CAROLINA

AEC Project #21032

Designed and Prepared For:

Haywood County Schools
401 Farmview Road
Waynesville, NC 28786

Designed and Prepared By:

Affinity Environmental Consulting, LLC
P.O. Box 7153
Asheville, North Carolina 28802
(828) 508-3812

Submitted: April 17, 2021
Designer: Mike G. Cook
NC Accreditation No.: 40433

A handwritten signature in black ink, appearing to read "Mike G. Cook", is positioned above a horizontal line.

TABLE OF CONTENTS

TECHNICAL SPECIFICATIONS

| Division 1 - General Requirements | Page Number |
|---|--------------------|
| 01043 Project Coordination | 01043-1 |
| 01092 Codes and Regulations | 01092-1 |
| 01410 Air Monitoring - Industrial Hygiene Firm Services | 01410-1 |
| 01503 Temporary Facilities | 01503-1 |
| 01513 Negative Pressure System | 01513-1 |
| 01526 Work Area Preparation | 01526-1 |
| 01560 Worker Protection | 01560-1 |
| 01562 Respiratory Protection | 01562-1 |
| 01563 Decontamination Units | 01563-1 |
| 01711 Project Decontamination | 01711-1 |
| 01714 Work Area Clearance | 01714-1 |
| Division 2 - Site Work | |
| 02080 Asbestos Removal | 02080-1 |
| 02084 Disposal of Asbestos-Containing Waste Material | 02084-1 |

APPENDICES

| | |
|--|------------|
| Appendix A Prework Asbestos Inspection Checklist | Appendix A |
| Appendix B Decontamination Area Arrangement | Appendix B |
| Appendix C Abatement Drawing | Appendix C |

SECTION - 01043

PROJECT COORDINATION

1.01 GENERAL

- A. All asbestos abatement contractors will be licensed general contractors in either the specialty interior, building, unclassified or asbestos categories by the North Carolina Licensing Board of General Contractors and limited for the bid amount.
- B. The contractor shall be responsible for inspecting the site prior to bidding to confirm the scope of the work. Any quantities listed by the designer in the plans, specifications or survey are done so as approximations. The actual quantities of asbestos-containing material to be encountered are the responsibility of the contractor.
- C. The contractor shall furnish and is responsible for all costs including, but not limited to: permit fees, containment preparation, labor, materials, services, insurance, bonding, and equipment necessary to carry out the abatement operations and disposal of all asbestos material in accordance with the plans and specifications, the EPA and OSHA regulations, and any applicable state and local government regulations.
- D. The contractor/employer has and assumes the responsibility of proceeding in such a manner that he offers his employees a workplace free of recognized hazards causing or likely to cause death or serious injury. The contractor shall be responsible for performing this abatement and disposal so that airborne asbestos fiber levels do not exceed established levels.
- E. The contractor will be responsible for all costs associated with employee monitoring to meet the OSHA requirements.
- F. The contractor is responsible for all costs, including additional visits, should the designer and/or the industrial hygiene firm determine that the contractor failed a final inspection. Notification and scheduling of the final inspection during the project is the responsibility of the contractor. The contractor will allow a minimum notice of 48 hours unless a different time frame is agreed upon by the designer and the contractor.

1.02 PERSONNEL

A. Supervisor

1. All supervisors shall be accredited by the Health Hazards Control Unit (HHCU).
2. All supervisors on the project shall have two years experience in the administration and supervision of asbestos abatement projects including work practices, protective measures for building and personnel, disposal procedures, etc.
3. One supervisor shall be provided for every 10 workers inside the containment. A minimum of one supervisor shall be provided per project.
4. The contractor shall have at least one employee on the job site in either a foreman or supervisor's position who is bilingual in the appropriate languages when employing workers who do not speak fluent English.
5. A minimum of one supervisor per company shall have attended a 24-hour respiratory protection course.

B. Worker

1. All workers shall be accredited by the HHCU.

C. Competent Person

1. A competent person, as defined in the OSHA asbestos standard 29 CFR 1926.1101, employed by the contractor must be outside the work area at all times to monitor activity, ensure containment security, provide information to visitors, and provide access to the work area.

D. Employees

1. The contractor is responsible for the behavior of workers within his employment. If at any time during the contracted work, any of his employees are judged to exhibit behavior unfitting for the area or judged to be a nuisance by the owner or designer, the contractor shall remove them immediately from the project.
2. The contractor shall be responsible for compliance with the following concerning employee behavior:
 - a. Under no circumstances are alcohol, drugs or any other type of controlled substances permitted on state property.

- b. All workers are restricted to the construction project site only.
 - c. All vehicles must be parked in areas prearranged with the owner.
 - d. All workers must conform to the following basic dress code when in public areas of the project confines: long pants, shirts, no tank tops, no shorts, no bare backs.
 - e. The contractor is responsible for disposal of all trash brought on state property by his employees, including drink cans, bottles or other food containers and wrappers.
3. Failure to adhere to these rules could result in criminal prosecution and/or removal from the State property.

1.03 MEETINGS

A. Pre-bid

1. No pre-bid conference will be held for this project. Contractors may contact Mr. Barandon McGaha, Special Projects Lead for Haywood County Schools, at (828) 593-9257 during regular business hours with any questions or to visit site if desired.

1.04 PRE-JOB SUBMITTALS

- #### **A. Submit three complete, bound sets of pre-job submittals to the designer at least 10 days prior to start of work. Work is prohibited until submittal package has been reviewed and approved by designer. A copy of the approved submittals shall be kept in a three-ring binder (project log) by the contractor at the project site in the clean room or in the on-site office of the contractor.**
1. **Notifications:** Provide copies of Asbestos Permit Application and Notification for Demolition/Renovation (DEHNR 3768), which provide written notice to all required agencies, including North Carolina HHCUC. Provide notification letters to local EMS, fire and police departments.
 2. **Employee List:** Provide copies of lists of supervisors and workers, along with their accreditation and Social Security numbers, to be utilized on the project.
 3. **Permits:** Provide copies of approval of a waste disposal site in compliance with 40 CFR 61.154.

4. Medical: Include individually signed and notarized forms by each worker to be utilized on the project documenting that each is actively involved in a company employee medical surveillance program.
5. Initial Exposure Assessment as required by OSHA 29 CFR 1926.1101.
6. Respirator Training: Copies of most recent fit testing records, individually signed, for each worker to be utilized on the project.
7. Any other programs or training as outlined by the OSHA and EPA standards.
8. A copy of the license of the electrician to be used on the project.
9. A copy of personnel air monitoring from previous asbestos abatement projects.

1.05 POST-JOB SUBMITTALS

- A. Submit three complete, bound sets of post-job submittals to the designer following the final completion of the work. Requests for final payment will not be approved until the submittal package has been reviewed and approved by the designer.
 1. Affidavits: Contractor's affidavit of payment of debts and claims, affidavit of release of liens, and consent of Surety Company to final payment.
 2. Manifest: North Carolina Asbestos Waste Shipment Record (DEHNR 3787) receipt from landfill operator which acknowledges the contractor's delivery(s) of waste material. Include date, quantity of material delivered and signature of authorized representative of landfill. Also, include name of waste transporter.
 3. Daily Log: A notarized copy of all daily logs showing the following: name, date, entering and leaving time, company or agency represented, reason for entry for all persons entering the work area, employee's daily air monitoring data as required by the OSHA standard and written comments by inspectors, industrial hygienists, designers and visitors.
 4. Medical: Copies of worker release forms, asbestos training certification forms and respirator training documentation of all new employees hired during the project.
 5. Special Reports: All documents generated under Section 01043.1.06.

1.06 SPECIAL REPORTS

- A. General: Except as otherwise indicated, submit special reports to designer within one day of occurrence requiring special report, with copies to others affected by occurrence. Also keep a copy in the project logbook.

- B. Reporting Unusual Events: When an event of unusual and significant nature occurs at site (examples: failure of negative pressure system, rupture of temporary enclosures), prepare and submit a special report to the designer immediately, listing chain of events, persons participating, response by contractor's personnel, evaluation of results or effects, and similar pertinent information. When such events are known or predictable in advance, advise designer in advance at earliest possible date.

1.07 CONTINGENCY PLAN

- A. Contingency Plan: Prepare a contingency plan for emergencies including fire, accident, power failure, negative pressure system failure, supplied air system failure (if applicable), evacuation of injured persons for both life threatening and non-life threatening, or any other event that may require modification or abridgment of decontamination or work area isolation procedures. Include in plan specific procedures for decontamination or work area isolation. Note that nothing in this specification should impede safe exiting or providing of adequate medical attention in the event of an emergency. Keep these plans in the on-site office.

- B. Post outside/in clean room of Personnel Decontamination Unit:
 - 1. Telephone numbers and locations of emergency services including but not limited to, fire, ambulance, doctor, hospital, police, power company, telephone company and the North Carolina HHCU.
 - 2. A copy of Material Safety Data Sheets (MSDS) for any chemicals used during the asbestos project.
 - 3. The contractor shall post asbestos signs in each appropriate language as per the OSHA 29 CFR 1926.1101 standard.

SECTION 01092

CODES AND REGULATIONS

1.01 REFERENCE SPECIFICATIONS

The contractor shall assume full responsibility and liability for compliance with all applicable federal, state and local regulations pertaining to work practices, hauling, disposal, and protection of workers, visitors to the site, and persons occupying areas adjacent to the site.

Unless modified by these project specifications, all specifications for stripping, removal, repair and disposal work shall conform to the following specifications and standards, as applicable, as if completely reproduced herein.

- A. The following regulations published by the Environmental Protection Agency (EPA):
 - 1. "National Emissions Standards for Hazardous Air Pollutants Asbestos," 40 CFR Part 61, Subpart M.
 - 2. "General Provisions," 40 CFR Part 61, Subpart A.
 - 3. "Guidance for Controlling Asbestos-Containing Materials in Buildings" June 1985. (EPA # 560/5-85-024).
 - 4. "Asbestos-Containing Materials in Schools," 40 CFR Part 763, Subpart E including appendices.

- B. The following regulations published by the U.S. Department of Labor, OSHA:
 - 1. "Occupational Exposure to Asbestos, Tremolite, Anthophyllite, and Actinolite; Final Rules," Title 29, Part 1910, Section 1001 and Part 1926, Section 1101 of the Code of Federal Regulations.
 - 2. "Respiratory Protection," Title 29, Part 1910, Section 134 of the Code of Federal Regulations.
 - 3. Construction Industry, Title 29, Part 1926, of the Code of Federal Regulations.
 - 4. "Access to Employee Exposure and Medical Records," Title 29, Part 1910, Section 20 of the Code of Federal Regulations.

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
CANTON MIDDLE SCHOOL
CANTON, NORTH CAROLINA

5. "Hazard Communication," Title 29, Part 1926, Section 59 of the Code of Federal Regulations.
 6. "Specifications for Accident Prevention Signs and Tags," Title 29, Part 1910, Section 145 of the Code of Federal Regulations.
- C. The following regulations published by North Carolina state agencies:
1. North Carolina Asbestos Hazard Management Program Rules as adopted by 15A NCAC 19C .0600.
 2. "North Carolina Occupational Safety and Health Standards for the Construction Industry," 29 CFR Part 1926 as adopted by T13 NCAC 07F .0201, and shipyard T13:07F.0500.
 3. North Carolina General Statutes, Chapter 95, 97, 130.
- D. The following documents published by the American National Standards Institute:
1. "Fundamentals Governing the Design and Operation of Local Exhaust Systems," Z9.2-1979.
 2. "American National Standard for Respiratory Protection Respiratory Use - Physical Qualifications for Personnel," Z88.6-1984.
 3. "Practices for Respiratory Protection," Z88.2-1992.

1.02 NOTICES

- A. The contractor shall notify the following offices in writing within the time frame specified by the NESHAP regulations prior to beginning any asbestos removal operations.
1. State Agencies

Health Hazards Control Unit
Occupational & Environmental Epidemiology Branch
N.C. DHHS
1912 Mail Service Center
Raleigh, N.C. 27699-1912
Telephone: (919) 707-5950

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
CANTON MIDDLE SCHOOL
CANTON, NORTH CAROLINA

N.C. Department of Labor
Division of Occupational Safety and Health
4 West Edenton Street
Raleigh, N.C. 27603
Mail: 1101 Mail Service Center
Raleigh, N.C. 27699-1101
Telephone: 1-800-LABOR-NC

2. Local Programs

When work is performed in Buncombe, Mecklenburg, or Forsyth counties, the air quality programs in these counties must be notified and their regulations shall be adhered to. Addresses of these agencies can be found on page 3 of DEHNR (3768) form. Phone numbers are listed below.

| | |
|--------------------|----------------|
| Buncombe County | (828) 250-6776 |
| Forsyth County | (336) 703-2440 |
| Mecklenburg County | (704) 336-5430 |

3. Emergency Departments

Notify the local emergency medical services, police and fire departments in writing of the type and scope of work being performed and request these departments make an inspection prior to beginning the work.

4. Licenses

Maintain current licenses for contractor and accreditation for workers and supervisors as required by applicable State or local jurisdictions for the removal, transporting, disposal or other regulated activity relative to the work of this contract.

5. A courtesy notification for any amount of asbestos, regulated or non-regulated, to be removed shall be sent to the HHCU 10 working days prior to the start date of the asbestos removal.

SECTION 01410

AIR MONITORING - INDUSTRIAL HYGIENE FIRM

1.01 GENERAL

- A. The owner shall be responsible for the coordination and contracting of an industrial hygiene firm. The owner will pay for the services of the industrial hygiene firm.
- B. Air monitoring shall be done under the direct supervision of a North Carolina accredited supervising air monitor (SAM), except for sampling performed by the contractor to satisfy OSHA requirements.
- C. SAM shall be accredited per the Asbestos Hazard Management Program rules.
- D. Air monitor shall be accredited as per the Asbestos Hazard Management Program rules and work under the direct supervision of a SAM.
- E. The industrial hygiene firm shall submit copies of their N.C. accreditations and documentation on respiratory protection training to the designer prior to the award of the contract.
- F. If specific project activities are assigned to an air monitor, the SAM is expected to be in direct control and responsible for industrial hygiene work completed on the project. The SAM shall approve and sign all air monitoring results performed by the air monitor. The SAM signature must be an original. No rubber stamp signature shall be accepted.
- G. Employees of the HHCU shall have right of entry into the project. The HHCU's SAM shall have final authority over the industrial hygiene firm on the project.

1.02 DESCRIPTION OF WORK

- A. The industrial hygiene firm shall offer expertise to the designer and contractor, but is not directly responsible for the performance of the job.
- B. At the job site, the industrial hygiene firm is expected to observe, be aware, and comment on general work site conditions and activities as they relate to the specifications and profession of industrial hygiene, and make recommendations in writing to the designer and contractor.

- C. The industrial hygiene firm is responsible for overseeing the protection of the environment from contamination, protection of persons in adjacent areas, and assurance that the areas are acceptable for occupancy.
- D. The industrial hygiene firm has the authority to direct the contractor relative to safety and environmental concerns. This includes stopping the work if necessary. All directions and comments made by the industrial hygiene firm to the contractor shall be written with a copy to the designer.
- E. The industrial hygiene firm shall furnish the contractor a copy of his field report within 24 hours of the visit. Copies of field notes and reports of observations shall be kept in project logbook.
- F. The SAM shall review and make comments to the designer on the submittals listed in Section 01043.
- G. The SAM shall approve any change in contractor's respiratory protection. This includes a review of the historical data.
- H. The industrial hygiene firm is to conform to the contractor's schedule and shall respond to necessary changes provided an advance notice is given as outlined in Section 01043.
- I. The industrial hygiene firm's project monitor shall furnish designer and contractor with a pager or mobile phone number where he can be reached quickly at all times.
- J. The industrial hygiene firm shall notify the designer and contractor, in writing, of any failed clearance visits.
- K. At the completion of the project, the industrial hygiene firm shall prepare a report describing the assessment of the project, all air monitoring data, acceptance letters, calibration records, and a description of the project as it proceeded to completion and submit four copies of the report to the designer.

1.03 AIR MONITORING

- A. **Ambient Air Monitoring:** The purpose of ambient air monitoring by the industrial hygiene firm will be to detect discrepancies in the work area isolation such as:
 - 1. Contamination of the building outside of the work area with airborne asbestos fibers.
 - 2. Failure of filtration or rupture in the negative pressure system.

3. Confirm the work practices established by the contractor and respiratory protection provided for employees are adequate.
- B. **Work Area Airborne Fiber Levels:** The owner's industrial hygiene firm will monitor airborne fiber levels in the work area. The purpose of this air monitoring will be to detect airborne fiber levels which may challenge the ability of the work area isolation procedures to protect the balance of the building or outside of the building from contamination by airborne fibers.
 - C. **Work Area Clearance:** To determine if the elevated airborne fiber levels encountered during abatement operations have been reduced to an acceptable level, the industrial hygiene firm will sample and analyze air per Section 01714.
 - D. In accordance with AHMB Program Rules, the SAM shall develop an Abatement Project Monitoring Plan which complies with EPA and OSHA analytical criteria and will provide a valid representation of airborne fiber concentrations both inside and outside the work area. This program is not intended to satisfy the contractor's requirement for sampling under the OSHA regulation. All personnel and area sampling conducted by the industrial hygiene firm shall be personally observed. Air sampling pumps shall not be left unattended for extended periods of time.
 1. The SAM shall submit a written project-monitoring plan to the designer with a copy to the contractor. The following information shall be required for the submittal.
 - a. The name, address, and telephone number of the industrial hygiene firm.
 - b. The name, address, telephone number and NIOSH's PAT designation and proficiency data for the laboratory analyzing the air samples. Analysis of all samples collected shall be by a laboratory currently proficient in NIOSH's "Proficiency Analytical Testing Program for Laboratory Quality Control" for asbestos. The acceptable sampling and analysis method is NIOSH 7400, latest revision.

Persons performing phase contrast microscopy analysis at the asbestos removal location shall be proficient in the American Industrial Hygiene Association's Asbestos Analyst Registry Program [AAR].
 - c. A proposed air sampling strategy which shall include: a projected number of air samples, locations, the types of air samples to be collected (personal, area, ambient), how the air samples are to be collected (TWA, ceiling, other), the equipment to be used (pumps,

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
CANTON MIDDLE SCHOOL
CANTON, NORTH CAROLINA

calibration equipment, filters, other), and how the samples will be transported to the laboratory.

1. All personal air samples will be collected in such a manner as to comply with OSHA collection and analytical regulations and to provide a valid representation of airborne fiber levels. The samples collected by the industrial hygiene firm on personnel do not satisfy the contractor's responsibility under OSHA.
 2. All final area air sampling will comply with all State and Federal requirements in measuring airborne asbestos following an abatement action.
 3. Air samples will be analyzed and results made available as per the AHMB Program Rules. Copies of all air-sampling results shall be signed by the SAM and a copy posted at the job site. These copies shall include the following: sample number, sample location, activity represented by sample, flow rate, sample time, comments and sample results. A statement will be included on each submission that the requirements of this contract have been met as they apply to the activities of the SAM.
 4. If TWA samples are being collected by the contractor for the purpose of reducing respiratory protection requirements, the industrial hygiene firm shall directly observe the conditions and work practices represented by each sample and make appropriate notes in the bound book on site. The SAM shall review all TWA air-sampling results which are used for reducing respiratory protection requirements before accepting the results.
- E. Supplemental air monitoring may be conducted inside and outside the work area by the HHCU. This supplemental sampling does not fulfill air-monitoring responsibilities required by OSHA, EPA or this contract.
- F. Daily air samples shall be read on site by a North Carolina Accredited Air Monitor rated as proficient in the AAR Program.

SECTION 01503

TEMPORARY FACILITIES

1.01 GENERAL

- A. Provide temporary connection to existing building utilities or provide temporary facilities as required herein or as necessary to carry out the work.
- B. Use qualified tradesmen for installation of temporary services and facilities. Locate, modify and extend temporary services and facilities where they will serve the project adequately and result in minimum interference with the performance of the work.

1.02 WATER SERVICE

- A. Owner shall supply a source of water. Contractor bears all expense of heating and getting water to the work and decontamination areas.
- B. Supply hot and cold water to the decontamination unit in accordance with Section 01563. Hot water shall be supplied at a minimum temperature of 100 degrees Fahrenheit.
- C. After completion of use, connections and fittings shall be removed without damage or alteration to existing water piping and equipment.

1.03 ELECTRICAL SERVICE

- A. General: Comply with applicable NEMA, NEC and UL standards and governing state and local regulations for materials and layout of temporary electric service.
- B. Ground Fault Protection: Provide receptacle outlets equipped with ground fault circuit interrupters, reset button and pilot light, for plug-in connection of power tools and equipment.
- C. Provide a weatherproof, grounded temporary electric power service and distribution system of sufficient size, capacity and power characteristics to accommodate performance of work during the construction period.
- D. Install temporary lighting adequate to provide sufficient illumination for safe work and traffic conditions in every area of work.
- E. Provide services of an electrician, on a standby basis, to service electrical needs during the abatement process.

- F. Provide additional power service and distribution service, consisting of individual dedicated 15 amp 120 volt circuits to electrical drops with receptacle outlets equipped with ground fault interrupt protection, color coded for the exclusive use of the industrial hygiene firm.

1.04 FIRST AID

- A. A minimum of one first-aid kit shall be located in the clean room. Additional first aid kits as the contractor feels is adequate or is required by law shall be located throughout the work area.

1.05 FIRE EXTINGUISHERS

- A. Comply with the applicable recommendations of NFPA Standard 10 - "Standard for Portable Fire Extinguishers." Locate fire extinguishers where they are most convenient and effective for their intended purpose, but provide not less than one extinguisher in each work area equipment room and one in the clean room of the personnel decontamination unit.

1.06 TOILET FACILITIES

- A. Provide temporary toilet facilities to be used by contractor's employees.

1.07 PARKING

- A. Park only in areas designated by the owner.

1.08 BUILDING SECURITY

- A. Maintain personnel on-site at all times any portion of the work areas are open or not properly secured. Secure work areas completely at the end of each day.

1.09 STORAGE

- A. Supply temporary storage required for storage of equipment and materials for duration of project. Trailer and storage dumpsters will be maintained in areas designated by the owner.

SECTION 01513

NEGATIVE PRESSURE SYSTEM

1.01 GENERAL

- A. High efficiency particulate air (HEPA) filter exhaust systems equipped with new HEPA filters for each project shall be used. Exhaust equipment and systems shall comply with ANSI Z9.2-79 and used according to manufacturer's recommendations.
- B. A system of HEPA-equipped air filtration devices shall be configured so that a pressure differential is established between the work area and the surrounding area (-0.02 to -0.04" water column). A continuous chart-recorded manometer shall be used to confirm this condition.
- C. Additional air filtration devices shall be provided inside the work area for emergency standby as well as for circulation of dead air spaces.
- D. The pressure differential is maintained at all times after preparation is complete and until the final visual inspection and air tests confirm the area is clean and acceptable for occupancy and the designer confirms verbally with written follow-up to discontinue the use of the negative pressure system.
- E. Air shall be exhausted outside. Any variations must be approved by the HHCU.
- F. The contractor shall check daily for leaks and log his checks in the bound logbook. This includes checks internal to air-moving devices.
- G. There shall be a minimum of four air changes per hour in any containment.

SECTION 01526

WORK AREA PREPARATION

1.01 GENERAL

- A. Before work begins in an area, a decontamination unit must be in operation as outlined in Section 01563. The decontamination unit shall insure that the abatement work area is completely isolated from other parts of the building.
- B. Temporary facilities shall be addressed as outlined in Section 01503.
- C. The contractor shall wet up a work area, load out, and decontamination area as shown in the plans and specifications. Any variations must be approved by the designer. The decontamination facility outside of the work area shall consist of a change room, shower room, and equipment room as described in Section 01563.
- D. The contractor shall wet clean and/or HEPA vacuum all items and equipment in the work area suspected of being contaminated with asbestos, but not in direct contact with the asbestos material and either secure these items in place with polyethylene sheeting or have them removed from the work area.
- E. Critical Barriers: The contractor shall thoroughly seal the work area for the duration of the work. The sealant materials used shall have appropriate fire ratings.
- F. The floors will have two layers of 6-mil (minimum) polyethylene plastic sheeting with joints overlapped 24 inches and taped securely. Plastic shall be carried up walls a minimum of 12 inches and secured.
- G. The walls will have one layer of 4-mil (minimum) polyethylene plastic sheeting with joints lapped 24 inches and taped securely. Plastic shall be lapped over floor coverings and taped securely.
- H. Floors and walls shall be installed in such a manner that they may be removed independently of the critical barriers.
- I. Entrances and exits from the work area will have triple barriers of polyethylene plastic sheeting so that the work area is always closed off by one barrier when workers enter or exit.
- J. No water may be left standing on the floor at the end of the workday.

- K. The contractor shall establish and mark emergency and fire exits from the work area. Emergency procedures shall have priority over established decontamination entry and exit procedures. Audible and visible fire and emergency evacuation alarms shall be installed so as to be heard and seen throughout the entire work area.
- L. Integrity of these seals shall be regularly checked and maintained by the contractor.
- M. After work area preparation, the contractor shall notify the designer verbally with written follow-up that he is ready for a prework inspection.
- N. The Contractor shall take all necessary measures to prevent damage of the interior surfaces inside and outside the work area. The Contractor shall be responsible for any and all damages inside or outside the work area caused by the asbestos abatement operations including water damage, contamination, construction of the containment, or any other activity.

SECTION 01560

WORKER PROTECTION

1.01 GENERAL

- A. Provide worker protection as required by OSHA, state and local standards applicable to the work. Contractor is solely responsible for enforcing worker protection requirements at least equal to those specified in this Section.
- B. Each time the work area is entered the contractor shall require all persons to remove all street clothes in the changing room of the personnel decontamination unit and put on new disposable coverall, new head cover, and a clean respirator. Proceed through shower room to equipment room and put on work boots.
- C. Workers shall not eat, drink, smoke, chew gum or chew tobacco in the work area, the equipment room, the load out area, or the cleanroom.

1.02 WORKER TRAINING

- A. Train all workers in accordance with 29 CFR 1926 and North Carolina state regulations regarding the dangers inherent in handling asbestos, breathing asbestos dust, proper work procedures and personal and area protective measures.

1.03 MEDICAL EXAMINATIONS

- A. Provide medical examinations for all workers. Examination shall as a minimum meet OSHA requirements as set forth in 29 CFR 1926 and N.C. Workmen's Compensation Act Dusty Trades Examination Record (DEHNR Form 2796).

1.04 PROTECTIVE CLOTHING

- A. Provide disposable full-body coveralls and disposable head covers, and require that they be worn by all workers in the work area. Provide a sufficient number for all required changes, for all workers in the work area.
- B. Boots: Provide work boots with non-skid soles and, where required by OSHA, foot protection for all workers.
- C. Gloves: Provide work gloves to all workers and require that they be worn at the appropriate times. Do not remove gloves from work area. Dispose of work gloves as asbestos-contaminated waste at the completion of the project.

1.05 ADDITIONAL PROTECTIVE EQUIPMENT

- A. If required, powered air purifying respirators (PAPR's) with replaceable HEPA filters, disposable coveralls, head covers and footwear covers shall be provided by the contractor for the owner, the designer, Industrial hygiene firm and other authorized representatives who may inspect the job site.

1.06 DECONTAMINATION PROCEDURES

- A. Require that all workers use the following decontamination procedure as a minimum requirement whenever leaving the work area:
 - 1. Remove disposable coveralls, disposable head covers, and disposable footwear covers or boots in the equipment room.
 - 2. Still wearing respirators, proceed to showers. Showering is mandatory. Care must be taken to follow reasonable procedures in removing the respirator to avoid asbestos fibers while showering. The following procedure is required as a minimum:
 - a. Thoroughly wet body including hair and face.
 - b. With respirator still in place thoroughly wash body, hair, respirator face piece, and all exterior parts of the respirator.
 - c. Take a deep breath, hold it and/or exhale slowly, completely wet hair, face and respirator. While still holding breath, remove respirator and hold it away from face before starting to breathe.
 - d. Carefully wash face piece of respirator inside and out.
 - e. Shower completely with soap and water; rinse thoroughly.
 - f. Rinse shower room walls and floor prior to exit.
 - g. Proceed from shower to changing (clean) room and change into street clothes or new disposable work items.
 - 3. After showering, each employee shall inspect, clean and repair his respirator as needed. The respirator shall be dried, placed in a suitable storage bag and properly stored.

SECTION 01562

RESPIRATORY PROTECTION

1.01 DESCRIPTION OF WORK

- A. Instruct and train each worker involved in asbestos abatement in proper respirator use and require that each worker always wear a respirator, properly fitted on the face, in the work area from the start of any operation which may cause airborne asbestos fibers until the work area is completely decontaminated. Use respiratory protection appropriate for the fiber level encountered in the workplace or as required for other toxic or oxygen-deficient situations encountered.

1.02 GENERAL

- A. Provide workers with personally issued and marked respiratory equipment approved by NIOSH and MSHA and suitable for the asbestos exposure level in the work areas according to OSHA Standard 29 CFR 1926.1101 and other possible contaminants employees might be exposed to during the project.
- B. Provide respiratory protection from the time the first operation involved in the project requires contact with asbestos-containing materials (including construction of decontamination units, construction of airtight barriers/barricades, and placing of plastic sheeting on walls) until acceptance of final air clearance test results by the industrial hygiene firm.
- C. The minimum respiratory protection for the project during friable gross removal shall be powered air-purifying respirators (PAPR). The minimum respiratory protection for the glovebag removal shall be half-face negative pressure respirator with replaceable HEPA filters.
- D. The designer may, under certain circumstances, allow the contractor to use a half-face respirator with replaceable HEPA filters during the final cleaning phase. However, the eight-hour TWA air sampling data must document the exposure level, and the SAM must write a letter to the designer allowing the contractor to reduce respiratory protection.
- E. Respirator fit testing shall be performed as a minimum at the beginning of the project, at any change in respiratory protection equipment, and at any time during the project if requested by the employee or SAM. Fit testing is to be performed by one of the methods listed in the 29 CFR 1926.1101, Appendix C.

- F. If supplied air respirators are used, the contractor shall provide a minimum of Grade "D" breathing air as set forth in the Compressed Gas Association's "Commodity Specifications for Air," G-7.1. The contractor shall test for Grade "D" breathing air initially and daily thereafter. Daily testing is not needed if the contractor has an air purification system that has CO and organic purging capabilities as well as a continuous CO monitor and alarm calibrated at 10 ppm. The system must be calibrated at least once a week or when it is moved.
- G. Provide emergency backup air supply, egress SCBA or egress HEPA filters for each worker in work area at all times when Type-C (supplied air) respirators are required. Breathing air system shall provide one hour of reserve air, calculated for maximum crew size for emergency evacuation.
- H. Where Type C respirators are utilized, the contractor is required to have an employee in the vicinity of the source of air. The contractor shall take into account the location of the fresh air intake to ensure no pollutant source is in the vicinity. The audible alarm shall be located where the employees inside and outside containment can hear the alarm.
- I. Do not allow the use of single-use, disposable or quarter-face respirators for any purpose.
- J. The contractor may submit a new exposure assessment (as per 29 CFR 1926.1101) to the SAM with a request to downgrade to less protective respirators. The SAM will make a recommendation to the designer, who will issue a decision in writing to the contractor approving or denying his request. If the contractor disagrees with the decision, then the representative air sampling data may be reviewed by the HHCU for a final decision.

SECTION 01563

DECONTAMINATION UNITS

1.01 DESCRIPTION OF WORK

- A. Provide that the personnel decontamination unit be the only means of ingress and egress for the work area. Require that all materials exit the work area through the decontamination unit. Contractor shall comply with 29 CFR 1926.1101, specifically paragraph (j) Hygiene facilities and practices for employees.

1.02 GENERAL

Provide separate personnel decontamination units and equipment/loadout decontamination units when practical.

- A. Personnel Decontamination Unit
1. Provide a Personnel Decontamination Unit consisting of a serial arrangement of connected rooms or spaces, changing room, shower room, equipment room. Each shall be separated by a minimum of three curtain doorways. Require all persons without exception to pass through this decontamination unit for entry into and exiting from the work area for any purpose. Do not allow parallel routes for entry or exit. Do not remove equipment or materials through Personnel Decontamination Unit.
 2. Provide temporary lighting within decontamination units as necessary to reach an adequate lighting level.
 3. Maintain floor of changing room dry and clean at all times. Do not allow the overflow water from the shower to escape the shower room.
 4. Damp wipe all surfaces twice after each shift change with a disinfectant solution.
 5. Provide hot and cold water, drainage and standard fixtures including an elevated showerhead as necessary for a complete and operable shower. A water hose and bucket is not an acceptable shower.
 6. Arrange water shut off and drain pump operation controls so that a single individual can shower without assistance from either inside or outside of the work area.

7. Pump shower wastewater to drain. Provide 20-micron and 5-micron wastewater filters in line to drain. Change filters daily or more often if necessary.
 8. Visual Barrier: Where the decontamination area is immediately adjacent to and within view of occupied areas, provide a visual barrier of opaque plastic sheeting so that worker privacy is maintained and work procedures are not visible to building occupants. Where the area adjacent to the decontamination area is accessible to the public, construct a solid barrier on the public side of the sheeting to protect the sheeting. Construct barrier with wood or metal studs, max. 16 inches on center, covered with minimum 3/8-inch plywood.
- B. Decontamination Unit Contamination:
1. If the air quality in the decontamination unit exceeds 0.01 fibers per cc analyzed by PCM or 70 structures per mm squared analyzed by TEM or its integrity is diminished through use as determined by the designer or industrial hygiene firm, no employee shall use the unit until corrective steps are taken and approved by the designer and industrial hygiene firm.

SECTION 01711

PROJECT DECONTAMINATION

1.01 GENERAL

- A. Carry out a first cleaning of all surfaces of the work area including plastic sheeting, tools, scaffolding and/or staging by use of damp-cleaning and mopping and/or a high efficiency particulate air (HEPA) filter vacuum until there is no visible debris from removed materials or residue on plastic sheeting or other surfaces. Do not perform dry-dusting or dry-sweeping.
- B. Equipment shall be cleaned and all contaminated materials removed before removing polyethylene from the walls and floors.
- C. The contractor shall replace all prefilters and clean the inside and outside of the HEPA exhaust units.
- D. After polyethylene sheets have been removed from walls and floors, the contractor shall clean all surfaces in the work area with amended water and/or HEPA-filtered vacuum.
- E. After cleaning the work area, the contractor shall allow the area to thoroughly dry and then wet-clean and/or HEPA vacuum all surfaces in work area again.
- F. At the completion of the cleaning operation, the contractor's supervisor shall perform a complete visual inspection of the work area to ensure that the work area is dust- and fiber-free. If the supervisor believes he is ready for a final project decontamination inspection, he shall notify the designer.
- G. The designer shall contact the industrial hygiene firm and advise the firm of the final project decontamination inspection requested by the contractor.
- H. Final project decontamination inspection includes the visual inspection and air monitoring clearance.
- I. Visual inspection for acceptance shall be performed after all areas are dry.
- J. The industrial hygiene firm shall perform the final visual inspection and conduct the final air clearance. Any discrepancies found shall be documented in the form of a punch list.
- K. Final air sampling shall not commence until the visual inspection is completed and passed.

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
CANTON MIDDLE SCHOOL
CANTON, NORTH CAROLINA

- L. If the industrial hygiene firm finds that the work area has not been adequately decontaminated, cleaning and/or air monitoring shall be repeated at the contractor's expense, including additional industrial hygiene fees, until the work area is in compliance.
- M. After the work area is found to be in compliance, all entrances and exits shall be unsealed and the plastic sheeting, tape and any other trash and debris shall be disposed of in sealable plastic bags (6 mil minimum) and disposed of as outlined in Section 02084.
- N. All HEPA unit intakes and exhausts shall be wrapped with six-mil polyethylene before leaving the work area.
- O. After the industrial hygiene firm has approved the final project decontamination and the contractor has completed the tear down for occupancy by others, the designer shall perform the project final inspection as outlined in the general conditions.
- P. Any residual asbestos that may be present after removing critical barriers, that in the designer's judgment should have been cleaned during the precleaning phase prior to installing critical barriers, shall be cleaned and cleared at the contractor's expense.
- Q. There shall be appropriate seals totally enclosing the inspection area to keep it separate from clean areas or other areas where abatement is or will be in progress. Once an area has been accepted and passed air tests, loss of the critical barrier integrity or escape of asbestos into an already clean area shall void previous acceptance and tests. Additional visual and final air clearance sampling shall be required at the contractor's expense.

SECTION 01714

WORK AREA CLEARANCE

1.01 GENERAL

- A. Notification and scheduling of the final inspection during the project is the responsibility of the contractor.

1.02 FINAL CLEARANCE TESTING

- A. After the second cleaning operation and after the area is completely dry, the following procedure test shall be performed:
1. A final visual inspection shall be conducted by the industrial hygiene firm. The inspection shall be conducted following the guidelines set forth in the American Society for Testing and Materials, Standard Practices for Visual Inspection of Asbestos Abatement Projects, Designation: E1368.90. If the work area is found visibly clean, air samples will be collected by the industrial hygiene firm.
 2. During final clearance air monitoring, the accredited air monitor shall use aggressive air sampling techniques using a leaf blower or other device, except in crawlspace areas. See EPA-AHERA regulations (40 CFR Part 763, Subpart E, Appendix A).
 3. After completion of the visual inspection and passage of the visual inspection, final air clearance will be performed. Each regulated area of removal greater or equal to 160 square feet or 260 linear feet will be cleared using TEM methods. Regulated areas less than 160 square feet and 260 linear feet will be cleared using PCM methods.
 4. Samples to be analyzed using PCM (minimum of five samples using NIOSH 7400 method), then the maximum flow rate is 12 liters per minute, with a minimum sample size of 2000 liters for each sample. Clearance criteria shall be less than 0.01 F/cc for all samples analyzed.
 5. Samples to be analyzed using TEM analysis, the Mandatory Transmission Electron Microscopy Method described in 40 CFR Part 763, Subpart E, Appendix F shall be used. Clearance criteria shall be an arithmetic mean less than or equal to 70 structures per square millimeter or a z-test less than or equal to 1.65.
 6. Final clearance criteria shall be in accordance with AHMB Program Rules.

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
CANTON MIDDLE SCHOOL
CANTON, NORTH CAROLINA

7. The industrial hygiene firm shall immediately report the final air sampling clearance results to the designer.
8. The use of the negative pressure system may be discontinued after the industrial hygiene firm instructs the contractor that he has passed the final project decontamination inspection.

SECTION 02080

ASBESTOS REMOVAL

1.01 GENERAL

- A. Prior to starting asbestos removal, the contractor's equipment, work area, and decontamination units will be inspected and approved by the designer or designer's representative.
- B. All loose asbestos material removed in the work area shall be adequately wet, bagged, sealed and labeled properly before personnel breaks or end of shift.
- C. All plastic sheeting, tape, cleaning material, clothing and all other disposable material or items used in the work area shall be packed into sealable plastic bags (6 mil minimum) and treated as contaminated material.
- D. All material shall be double-bagged.
- E. All excess water (except shower water) shall be combined with removed material or other absorptive material and properly disposed of as per EPA regulations. Contractor shall not place water in storm drains, onto lawns, or into ditches, creeks, streams, rivers or oceans.

1.02. SCOPE OF WORK

Work in this project consists of furnishing of all labor, materials, equipment, and services reasonably incidental and implied for the removal of the asbestos-containing materials listed below from the "B" Building of Canton Middle School located at 60 Penland Street in Canton, North Carolina. The Contractor shall commence work to be performed included in these specifications as notified by the Owner.

The contractor shall remove approximately 4,755 square feet of asbestos-containing 9" x 9" floor tile and associated black mastic from the Media Center, Media Center Storage Rooms, and Room 407. The floor tile and mastic in Media Center is covered with carpet. The floor tile and mastic in the Media Center Storage Rooms is not covered with carpet. The floor tile and mastic in Room 407 is covered with laminate flooring. The contractor is to also remove all vinyl and wood baseboards in the removal areas. All cabinets, shelving, air handling units, radiators, and power panels are to be removed by the owner prior to asbestos abatement.

The contractor is to also submit an alternate bid for the removal of approximately 1,229 square feet of asbestos-containing 9" x 9" floor tile and associated black mastic from Rooms 408, 409, and the Lounge in the "B" Building.

Abatement areas are illustrated on Drawing D-01 located in Appendix C. See Technical Specifications and Drawing included in these specifications for additional information.

REMOVAL OF CARPET, FLOOR TILE, AND MASTIC

The Contractor has the option of removing the carpet, floor tile, and mastic using non-friable or friable methods.

Non-Friable Method – If the Contractor employs non-friable methods, 4-mil polyethylene shall be placed a minimum of three feet up each wall for protection of the walls during the removal of mastic. The Contractor shall only use approved non-friable methods (e.g., infrared heating). Open flame burning is prohibited. Barrier tape, warning signs, and negative air exhaust will be employed during removal. Operators of infrared heat machines shall be thoroughly trained in the proper use of the equipment.

Friable Method – If the Contractor employs friable methods, then the following shall be used: The Contractor shall place two layers of 4-mil polyethylene over all critical barriers, set up a full decontamination unit per these specifications, and place the work area under negative pressure using HEPA negative pressure air filtration units in accordance with Section 01513. One layer of 4-mil polyethylene shall be placed on the walls. Each work area of removal shall be setup as one continuous containment.

The floor tile and carpet shall be removed using wet methods, and the mastics will be removed using a low-odor, non-flammable, non-hazardous material approved by the manufacturer for the use of mastic removal. After completion of mastic removal, the Contractor shall use a cleaning solution to neutralize the mastic remover and mop and rinse the floor so that no residue of the mastic remover or mastic may be left on the floor surface. The cleaner shall be compatible with all typical mastics that may be used after the abatement is complete. The cleaner shall meet all requirements of the mastic remover above.

- A. The Contractor shall take all necessary precautions to prevent the spread of the mastic remover from areas outside of the containment. The Contractor will be responsible for all damages to walls and surfaces inside and outside of containment. The Contractor shall be responsible for returning any walls, surfaces, or other items splattered, damaged, or soiled back to original conditions if the Owner so chooses.
- B. The removed floor tiles, contaminated carpeting, and mastic removal byproducts shall be immediately placed in 6-mil polyethylene bags, double bagged, or sealed in 2 layers of polyethylene, and properly labeled. Workers shall remove the asbestos-containing flooring materials under negative pressure. Workers shall use respiratory protection and protective clothing when performing all removal procedures.
- C. The Contractor shall add cat litter, oil-sorb, or other material approved by the Asbestos Designer to the used mastic removal solution, so that no free standing liquid will be left in the waste disposal bags.
- D. The Contractor shall wet wipe and clean all surfaces prior to the final inspection. All areas of regulated (friable) removal will be cleared using air clearance protocol in Section 01704 “Work Area Clearance”. The Owner will be responsible for the first

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
CANTON MIDDLE SCHOOL
CANTON, NORTH CAROLINA

clearance. The Contractor shall pay air monitoring fees and TEM sample analysis fees for all additional clearances.

Bulk sample analysis results of the asbestos-containing materials are listed below.

| <u>Material</u> | <u>Asbestos Content</u> |
|-----------------|-------------------------|
| Carpet Glue | None Detected |
| Floor Tile | 5% Chrysotile |
| Black Mastic | 8% Chrysotile |

The bulk sampling results are available for review.

Any measurements or material amounts listed are given as estimates. The contractor is responsible for his/her own measurements and the removal of the asbestos-containing materials indicated in this project.

SECTION 02084

DISPOSAL OF ASBESTOS-CONTAINING WASTE MATERIAL

1.01 GENERAL

- A. All asbestos materials and miscellaneous contaminated debris shall be properly sealed and protected, and the loadout vehicle/dumpster shall be locked, while located on the facility site and then transported to a predesignated disposal site in accordance with 40 CFR 61.150 and DOT 49 CFR Parts 100-399.
- B. An enclosed vehicle will be used to haul waste material to the disposal site. No rental vehicles or trailers shall be used. Vehicle selection, vehicle covers and work practices shall assure that no asbestos becomes airborne during the loading, transport and unloading activity, and that material is placed in the waste site without breaking any seals.
- C. Waste disposal polyethylene bags (6 mil) and containers, non-porous (steel/plastic) drums or equivalent, with labels, appropriate for storing asbestos waste during transportation to the disposal site shall be used. In addition to the OSHA labeling requirements, all containers shall be labeled with the name of the waste generator and the location at which the waste was generated.
- D. The contractor shall transport the containers and bags of waste material to the approved waste disposal site. The sealed plastic bags shall be placed into the burial site unless the bags have been broken or damaged. Upon the landfill's approval, damaged bags shall be left in the non-porous containers and the entire contaminated package shall be buried. Uncontaminated containers may be reused.
- E. Workers loading and unloading the asbestos will wear respirators and disposable clothing when handling material. Asbestos warning signs shall be posted during loading and unloading of asbestos waste.
- F. The contractor shall use the HHCU's Waste Shipment Record for disposal records as per 40 CFR 61.150 and distribute a copy of all waste shipment records to the designer after the completion of the project.

APPENDICES

APPENDIX A

PREWORK ASBESTOS INSPECTION
CHECKLIST

APPENDIX A

PREWORK ASBESTOS INSPECTION CHECKLIST

Name of State Facility: _____

Project Name: _____

Project ID Number: _____

Date of Inspection: _____ Pass: _____ Fail: _____

| I. DOCUMENTS | YES | NO |
|--|------------|-----------|
| A. Asbestos Removal Permit/NESHAP Notification | _____ | _____ |
| B. Accreditation Documents for Workers & Supervisors | _____ | _____ |
| C. Asbestos Plans and Specifications | _____ | _____ |
| D. Air Monitoring Data | _____ | _____ |
| E. Waste Shipment Records | _____ | _____ |
| F. Sign-in Sheets and Bound Book for Comments | _____ | _____ |
| G. Calibration Record for Grade "D" Air | _____ | _____ |
| H. Items listed in Section 01043 of Specification | _____ | _____ |
| II. PPE SUPPLIES | | |
| A. Tyvek Clothing | _____ | _____ |
| B. Rubber Boots | _____ | _____ |
| C. Respirators with HEPA Filters | _____ | _____ |
| III. CLEAN ROOM | | |
| A. Entry Curtains | _____ | _____ |
| B. Emergency Phone Numbers Posted | _____ | _____ |
| C. First Aid Kit | _____ | _____ |
| D. Asbestos Signs | _____ | _____ |
| E. Decontamination Procedures Posted | _____ | _____ |
| F. Fire Extinguisher | _____ | _____ |
| IV. SHOWER ROOM | | |
| A. Polyethylene Curtains | _____ | _____ |
| B. Hot/Cold Water & Operational | _____ | _____ |
| C. Soap & Towels | _____ | _____ |

SPECIFICATIONS FOR REMOVAL OF ASBESTOS-CONTAINING FLOORING MATERIALS
 CANTON MIDDLE SCHOOL
 CANTON, NORTH CAROLINA

| | | | |
|-------------|---|------------|-----------|
| D. | Waste Water Filter Pump Operational | _____ | _____ |
| E. | Extra Five-Micron Size Filters | _____ | _____ |
| F. | Filtered Waste Water to Sanitary Sewer | _____ | _____ |
| V. | WORK AREA | YES | NO |
| A. | Removable Items Out of Area | _____ | _____ |
| B. | Non-removable Items Protected | _____ | _____ |
| C. | Critical Barriers Installed | _____ | _____ |
| D. | Polyethylene Curtains | _____ | _____ |
| E. | Polyethylene on Walls/Floors as Specified | _____ | _____ |
| F. | HVAC off | _____ | _____ |
| G. | Air Filtration Devices in Place and Operational | _____ | _____ |
| H. | Air Exhausted to Outside | _____ | _____ |
| I. | Electricity Locked and Tagged Out | _____ | _____ |
| J. | Temporary Power Installed with GFCI | _____ | _____ |
| K. | Fire Extinguishers | _____ | _____ |
| L. | Emergency and Fire Exits Marked | _____ | _____ |
| M. | Audible Alarms Operational | _____ | _____ |
| N. | Toilet Available | _____ | _____ |
| VI. | EQUIPMENT | | |
| A. | Safety Equipment | _____ | _____ |
| B. | HEPA Vacuums | _____ | _____ |
| C. | Waste Disposal Bags | _____ | _____ |
| D. | Airless Sprayer with Water Source | _____ | _____ |
| E. | Cleaning Equipment | _____ | _____ |
| F. | Glove Bags | _____ | _____ |
| G. | Emergency Power Generator (if required) | _____ | _____ |
| H. | Temporary Lighting | _____ | _____ |
| VII. | OTHER | | |
| A. | _____ | _____ | _____ |
| B. | _____ | _____ | _____ |
| C. | _____ | _____ | _____ |
| D. | _____ | _____ | _____ |

Asbestos Design Consultant


Date

Asbestos Contractor's Representative

Date

APPENDIX B


DECONTAMINATION AREA
ARRANGEMENT

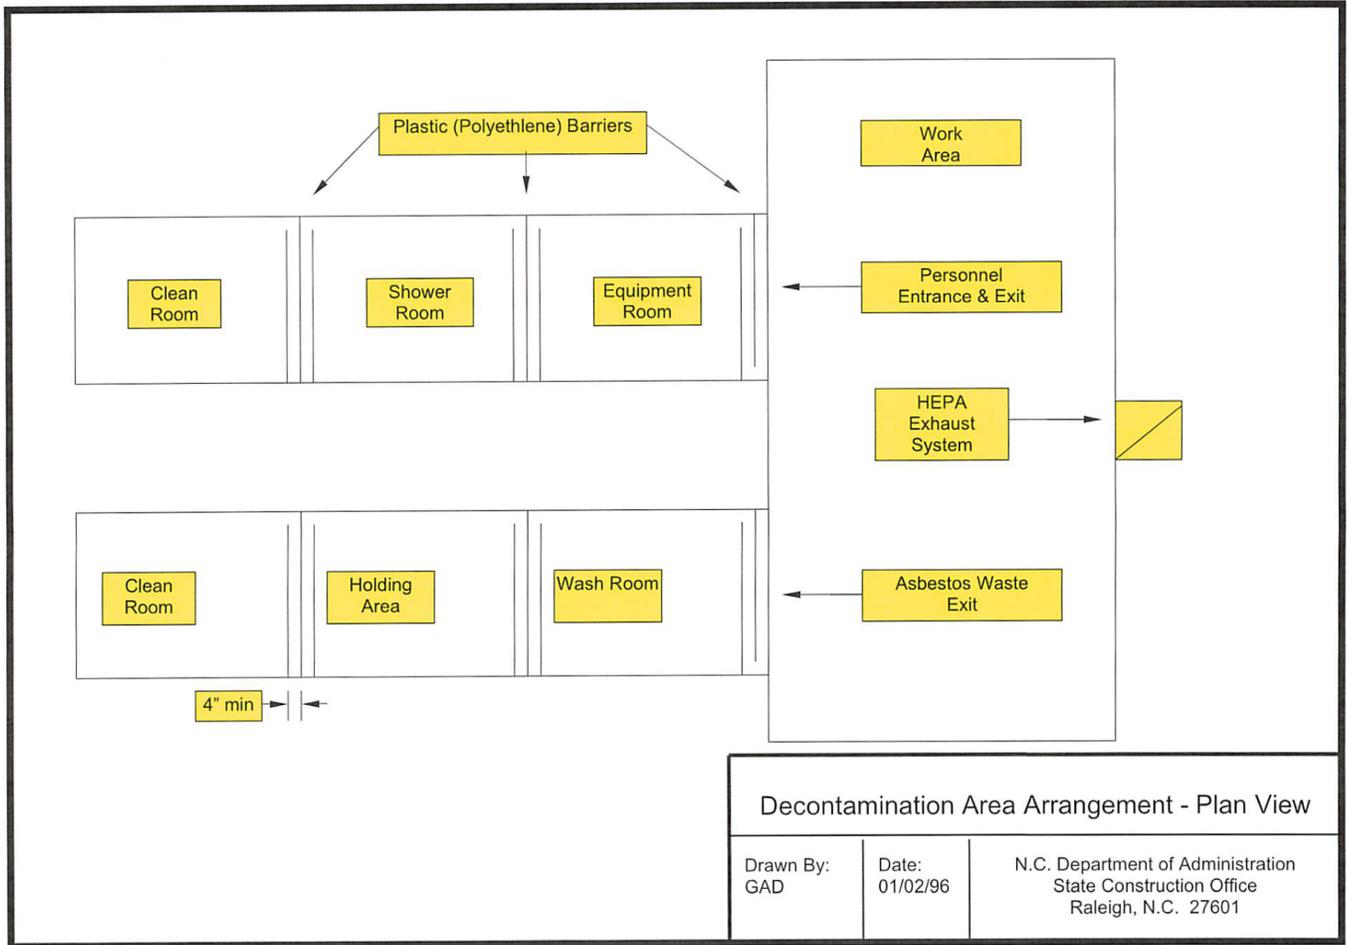

APPENDIX C

ABATEMENT DRAWING

Note: This Drawing is to be Viewed in Color.

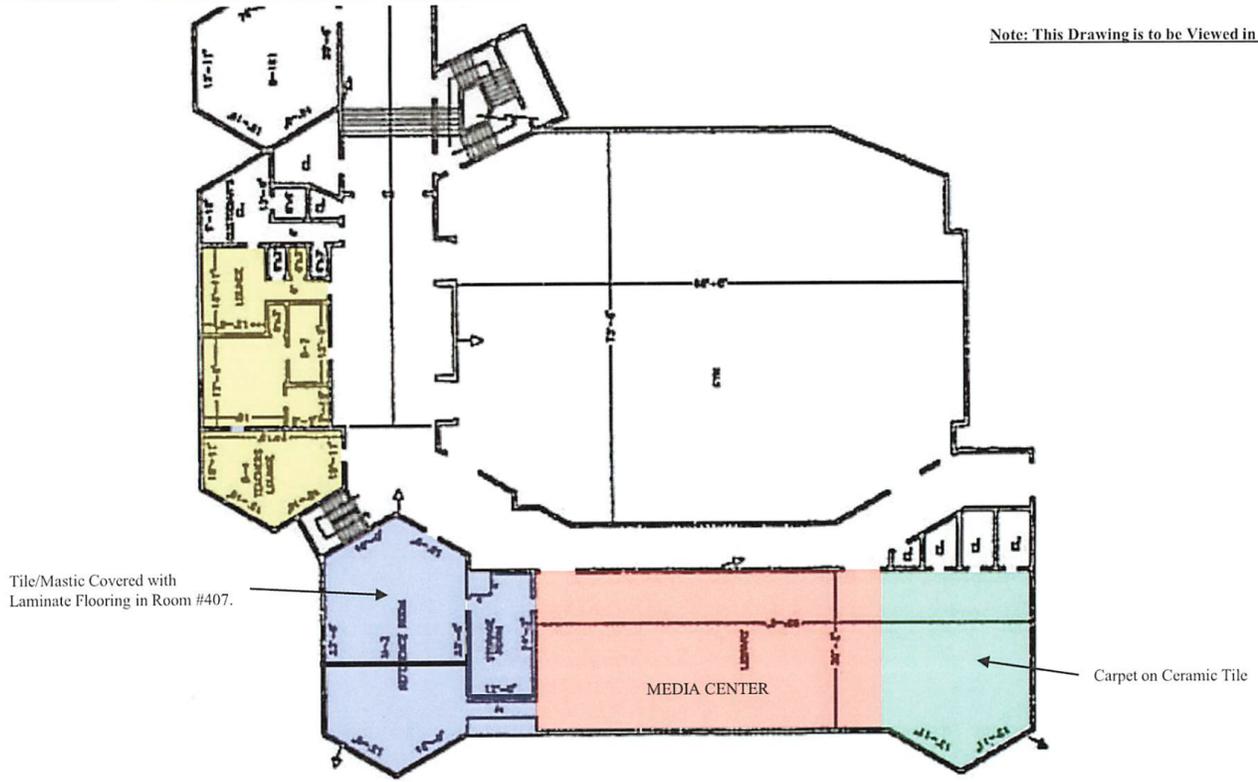

LEGEND

| | |
|--|--|
| | Represents Approximate Areas Where Contractor Is To Remove Carpet, Asbestos-Containing Floor Tile, and Asbestos-Containing Mastic. |
| | Represents Areas Where Contractor Is To Remove Asbestos-Containing Floor Tile & Mastic. |
| | Represents Areas Where Contractor Is To Remove Carpet. |
| | Represents Alternate Bid Areas Where Contractor Is To Remove Asbestos-Containing Floor Tile and Mastic. |

| | |
|-------------------------------------|---|
| Asbestos Abatement Locations | |
| Canton Middle School – “B” Building | |
| Canton, NC | |
| Scale: No Scale | Drawing #: D-01 |
| Date: 4/15/2021 |  |
| Drawn by: MGC | |
| AEC #21032 | |